

## **NOTES:**


- ALL UNITS ARE CUL LISTED & DESIGNED ACCORDANCE WITH INDUSTRY STANDARDS.
- ACCORDANCE WITH INDUSTRY STANDARDS.

  2. TRANSFORMERS ARE DRY—TYPE, CLASS
  AA, HOUSED WITHIN NEMA 1 ENCLOSURE
- FOR INDOOR / CONTROL-PANEL USE.

  3. DISCONNECT HAS DUAL BRACKET SYSTEM FOR BACK OR BOTTOM MOUNTING.
- 4. TRANSFORMERS ARE CONSTRUCTED BASED UPON A 40°C AMBIENT ENVIRONMENT.

**DRAWINGS** 

- 5. MAINTAIN 1" CLEARANCE FROM ALL LIVE PARTS.
- 6. PAINT COLOR IS RAL# 7042.

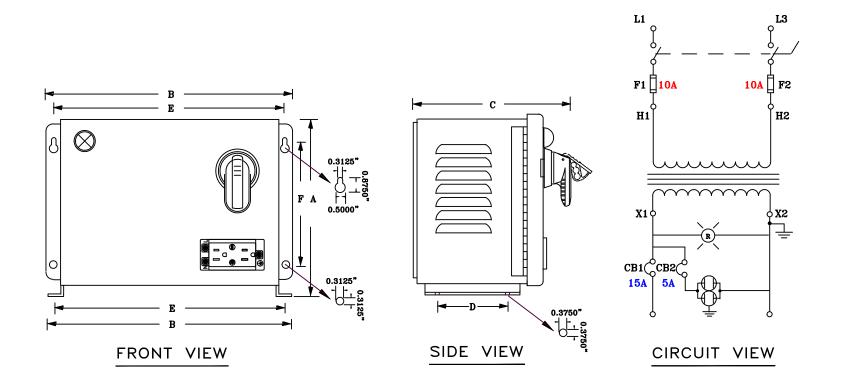

## APPROXIMATE DIMENSIONS ( INCHES )

KVA	А	В	С	D	E	F	HARDWARE	MTG SLOTS	ENCLOSURE	lbs.	WEATHER' SHIELD	TERMINAL TYPE
2.0	11.00	16.25	10.00	4.00	15.00	6.00	1/4-20	0.312" x 0.312"	PLD-MOD-UM	65	N/A	TBs

X APPROVAL RECORD \* ELECTROSTATIC SHIELD GROUNDED TO TRANSFORMER CASE AT FACTORY ( IF APPLICABLE ) □ OTHER PRIMARY CUST. 480 XXXXXXX VOLTAGE SECONDARY JOB 120 VOLTAGE TEMPERATURE 115 200kA SCCR FUSIBLE DISCONNECT SWITCH PRIMARY: RISE IN C WINDINGS & **COPPER ALUMINUM** SECONDARY: 15A DUPLEX RECEPTACLE and RED POWER-ON LIGHT TERMINALS FREQUENCY BY ENG. LOG. TITLE 1-PHASE, 600 VOLT CLASS 60 HERTZ LIGHTING DISCONNECT PRIMARY DATE DRY TYPE TRANSFORMER NONE TAPS MFG. LOG. DWG. NO. REV PLD-2000-A DWG. FILE DATE: