


TYPICAL WIRING DIAGRAM


NOTES:

1. ALL UNITS ARE cUL LISTED AND DESIGNED ACCORDANCE WITH INDUSTRY STANDARDS.
2. TRANSFORMERS ARE DRY-TYPE, CLASS AA, VENTILATED NEMA 2 ENCLOSED FOR INDOOR USE.
3. TRANSFORMERS ARE FLOOR MOUNTED.
4. AVAILABLE ACCESSORIES FOR THIS UNIT:
A) OUTDOOR WEATHERSHIELD KIT
B) WALL MOUNTING BRACKETS
5. TRANSFORMERS ARE CONSTRUCTED BASED UPON A 40°C AMBIENT ENVIRONMENT.
6. MAINTAIN 1" CLEARANCE FROM ALL LIVE PARTS.
7. PAINT COLOR IS ANSI #61.

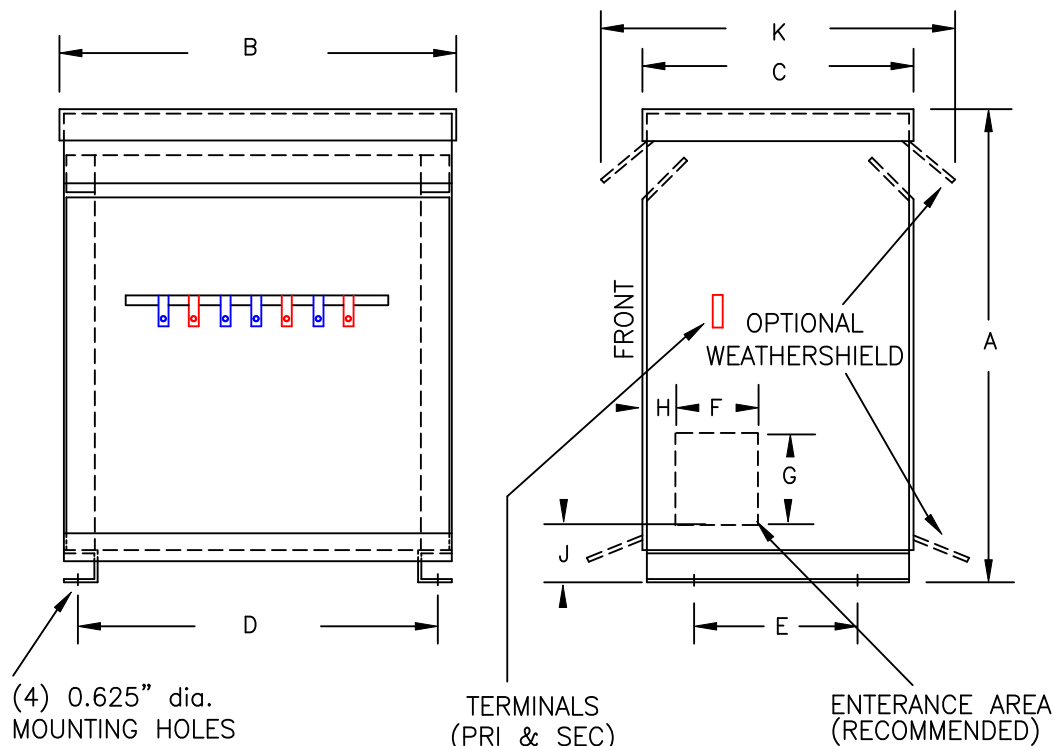

FRONT VIEW

SIDE VIEW

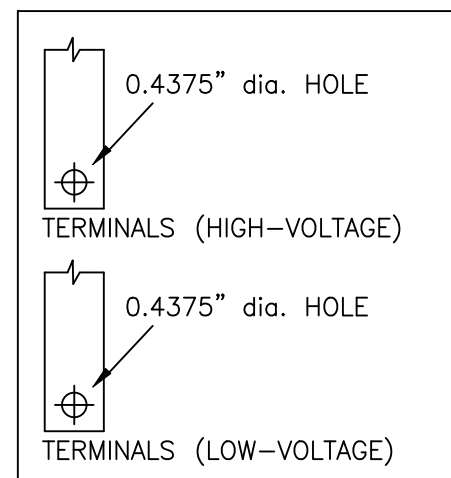

TERMINAL DETAILS

APPROXIMATE DIMENSIONS (INCHES)

KVA	A	B	C	D	E	F	G	H	J	K	L	BOX	lbs.	WEATHER SHIELD	TERMINAL TYPE
SEE BELOW	37.00	26.00	19.88	24.12	16.50	3.00	6.00	1.00	5.75	24.00	----	3PT-75K	485	WS-18A	BUSBAR

										DRAWINGS ☒ APPROVAL ☐ RECORD ☐ OTHER		
	300.0 KVA		240.0 KVA									
INPUT VOLTAGE	575Y/332		480Y/277		CUST.		XXXXXXXXXX					
OUTPUT VOLTAGE	480Y/277		400Y/231		JOB							
TEMPERATURE RISE IN °C	150				CATALOG							
WINDINGS & TERMINALS	☒	ALUMINUM		☐	COPPER		NOTE		XXXXXXXXXX			
FREQUENCY IN HERTZ	60				BY		ENG. LOG.		TITLE 3—PHASE, 600 VOLT CLASS AUTO DRY TYPE TRANSFORMER			
INPUT TAPS	546, 560, 589, 604				DATE							
					REV		MFG. LOG.		DWG. NO. 3PT485PA300			
					DATE:		DWG. FILE					

DRAWINGS
☒ APPROVAL
☐ RECORD
☐ OTHER