



NOTES:

- 1. ALL UNITS ARE CUL LISTED & DESIGNED ACCORDANCE WITH INDUSTRY STANDARDS.
- 2. TRANSFORMERS ARE DRY-TYPE, CLASS AA, VENTILATED NEMA 1 ENCLOSED FOR INDOOR USE.
- 3. TRANSFORMERS ARE FLOOR MOUNTED.
- 4. TRANSFORMERS ARE CONSTRUCTED BASED UPON A 40°C AMBIENT ENVIRONMENT.
- 5. MAINTAIN 1" CLEARANCE FROM ALL LIVE PARTS.
- 6. PAINT COLOR IS ANSI #61.

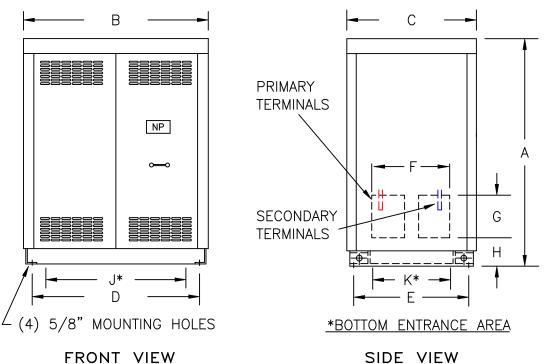



SIDE VIEW

TERMINAL DETAILS

APPROXIMATE DIMENSIONS (INCHES)

KVA	А	В	С	D	E	F	G	Н	J	К	ENCLOSURE	lbs.	WEATHER SHIELD	TERMINAL TYPE
550.0	72.00	53.38	44.38	49.00	42.00	12.63	16.00	4.25	37.00	37.00	3PT-550K-DIT	2750	N/A	BUSBAR

* ELECTROSTATIC SHIELD GROUNDED TO TRANSFORMER CASE AT FACTORY (IF APPLICABLE)

DRAWINGS X APPROVAL RECORD I □ OTHER

						· · · · · · · · · · · · · · · · · · ·				
PRIMARY VOLTAGE	480 DE	LTA	CUST.	XXXXXXXX	X		•			
SECONDARY VOLTAGE	400Y/2	231	JOB							
TEMPERATURE RISE IN *C	150		CATALOG							
WINDINGS & TERMINALS	X ALUMINUM	COPPER	NOTE	TE XXXXXXXX						
FREQUENCY IN HERTZ	60		BY	ENG. LOG.	TITLE	J THASE, OUD VOLT CLASS				
PRIMARY TAPS	456, 5	504	DATE		DRIVE ISOLATION DRY TYPE TRANSFORMER					
. DO	A ÆDI	REV	MFG. LOG.	DWG. NO.						
70	VVEITI	DATE:	DWG. FILE		3PTN657-550K-DIT					