


NOTES:

- 1. ALL UNITS ARE CUL LISTED & DESIGNED ACCORDANCE WITH INDUSTRY STANDARDS.
- 2. TRANSFORMERS ARE DRY-TYPE, CLASS
 AA, HOUSED WITHIN NEMA 1 ENCLOSURE
 FOR INDOOR / CONTROL-PANEL USE.
- 3. DISCONNECT HAS DUAL BRACKET SYSTEM FOR BACK OR BOTTOM MOUNTING.
- 4. TRANSFORMERS ARE CONSTRUCTED BASED UPON A 40°C AMBIENT ENVIRONMENT.

DRAWINGS

- 5. MAINTAIN 1" CLEARANCE FROM ALL LIVE PARTS.
- 6. PAINT COLOR IS RAL# 7042.

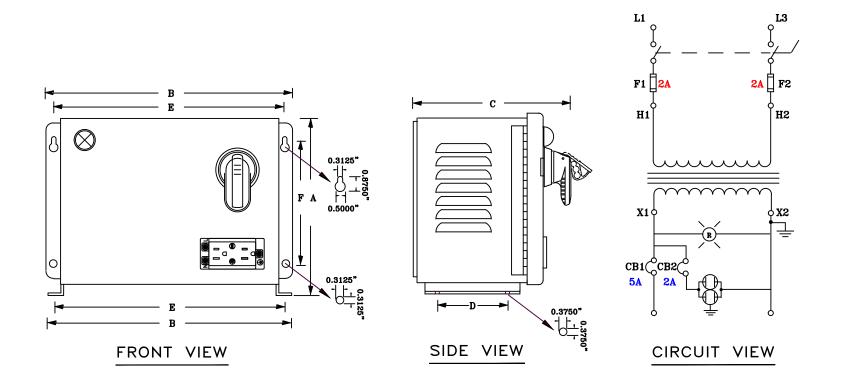

APPROXIMATE DIMENSIONS (INCHES)

KVA	Α	В	С	D	E	F	HARDWARE	MTG SLOTS	ENCLOSURE	lbs.	WEATHER' SHIELD	TERMINAL TYPE
0.500	11.00	16.25	10.00	4.00	15.00	6.00	1/4-20	0.312" x 0.312"	PLD-MOD-UM	35	N/A	TBs

	* ELE	CTROSTATIC SHIELD	GROUNDED TO	TRANSFORME	R CASE AT	FACTORY (IF APPLICABLE)	□ APPROVAL □ RECORD □ OTHER		
PRIMARY VOLTAGE	480		CUST.	XXXXXXXX					
SECONDARY VOLTAGE	120		JOB						
TEMPERATURE RISE IN °C	115		PRIMARY:	200kA SCCR FUSIBLE DISCONNECT SWITCH					
WINDINGS & TERMINALS	□ ALUMINUM	XI COPPER	SECONDARY:	15A DUPLEX	RECEPTACL	E and RED POWER—ON LIGHT			
FREQUENCY HERTZ	60		BY	ENG. LOG.	TITLE	1-PHASE, 600 VOLT CLASS LIGHTING DISCONNECT			
PRIMARY TAPS	NONE		DATE		DRY TYPE TRANSFORMER				
DO	A CERT	REV	MFG. LOG.	DWG. NO. PLD-500-A					
770	VVEITI	DATE:	DWG. FILE						