


NOTES:

- 1. ALL UNITS ARE CUL LISTED & DESIGNED ACCORDANCE WITH INDUSTRY STANDARDS.
- 2. TRANSFORMERS ARE DRY-TYPE, CLASS AA, HOUSED WITHIN NEMA 1 ENCLOSURE FOR INDOOR / CONTROL-PANEL USE.
- 3. DISCONNECT HAS DUAL BRACKET SYSTEM FOR BACK OR BOTTOM MOUNTING.
- 4. TRANSFORMERS ARE CONSTRUCTED BASED UPON A 40°C AMBIENT ENVIRONMENT. 5. MAINTAIN 1" CLEARANCE FROM ALL

DRAWINGS

- LIVE PARTS.
- 6. PAINT COLOR IS RAL# 7042.

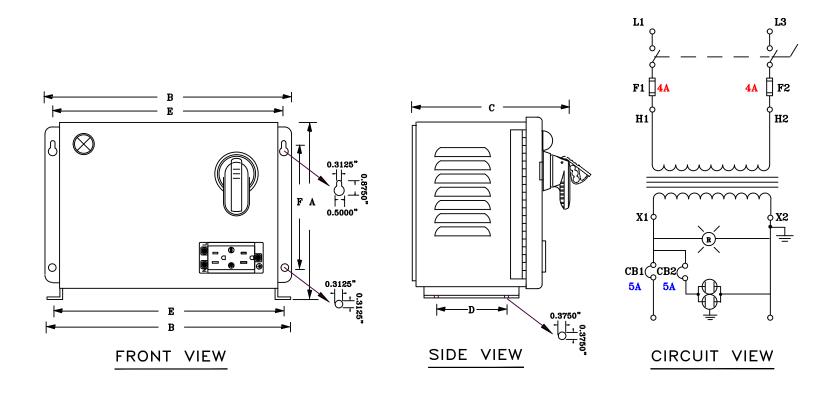

APPROXIMATE DIMENSIONS (INCHES)

KVA	А	В	С	D	E	F	HARDWARE	MTG SLOTS	ENCLOSURE	lbs.	WEATHER' SHIELD	TERMINAL TYPE
0.750	11.00	16.25	10.00	4.00	15.00	6.00	1/4-20	0.312" x 0.312"	PLD-MOD-UM	35	N/A	TBs

X APPROVAL RECORD * ELECTROSTATIC SHIELD GROUNDED TO TRANSFORMER CASE AT FACTORY (IF APPLICABLE) □ OTHER PRIMARY CUST. 480 XXXXXXX VOLTAGE SECONDARY JOB 120 VOLTAGE TEMPERATURE 115 200kA SCCR FUSIBLE DISCONNECT SWITCH PRIMARY: RISE IN C WINDINGS & **COPPER ALUMINUM** SECONDARY: 15A DUPLEX RECEPTACLE and RED POWER-ON LIGHT TERMINALS **FREQUENCY** BY ENG. LOG. TITLE 1-PHASE, 600 VOLT CLASS 60 HERTZ LIGHTING DISCONNECT PRIMARY DATE DRY TYPE TRANSFORMER NONE **TAPS** MFG. LOG. DWG. NO. REV PLD-750-A DWG. FILE DATE: