




1. ALL UNITS ARE cUL LISTED & DESIGNED WITH APPLICABLE NEMA, ANSI, AND IEEE STANDARDS.
2. TRANSFORMERS ARE DRY-TYPE, CLASS AA, VENTILATED NEMA 1 ENCLOSURE FOR INDOOR USE.
3. TRANSFORMERS ARE FLOOR MOUNTED.
4. TRANSFORMERS HAVE 220°C CLASS INSULATION SYSTEM WITH THE AVERAGE WINDING TEMPERATURE RISE BASED ON 40°C MAXIMUM AMBIENT.
5. PAINT COLOR IS ANSI #61.



(4) 5/8" MOUNTING HOLES

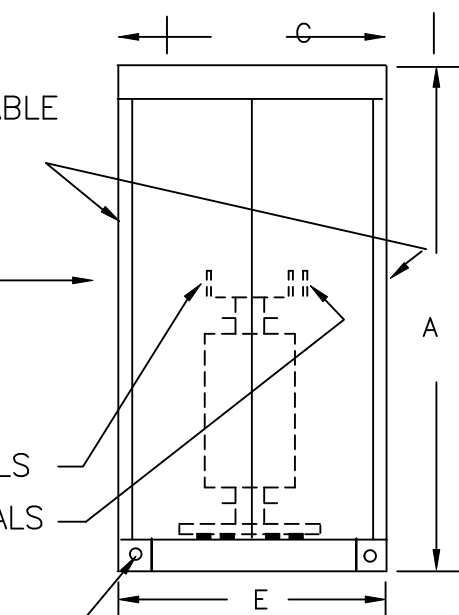

JACKING, TOWING & LIFTING PROV.

KVA	A	B	C	D	E	F	G	H	J	K	L	BOX	lbs.	WEATHER SHIELD	TERMINAL TYPE
1000.0	90.00	102.00	58.00	92.00	54.50	-----	-----	-----	-----	-----	-----	3-P	8800	N/A	BUSBAR

DRAWINGS
☒ APPROVAL
☐ RECORD
☐ OTHER

PRIMARY VOLTAGE	13200 DELTA (60kV BIL)		CUST.	XXXXXXXX	
SECONDARY VOLTAGE	208Y/120 (10kV BIL)		JOB		
TEMPERATURE RISE IN °C	150		CATALOG		
WINDINGS & TERMINALS	☒ ALUMINUM	☐ COPPER	NOTE BUSSED-TO-THE-ENDS (CLOSED-COUPLED to SWITCHGEAR)		
FREQUENCY IN HERTZ	60		BY	ENG. LOG.	TITLE 3-PHASE, HIGH VOLTAGE ISOLATION DRY TYPE TRANSFORMER
PRIMARY TAPS	+2, -2 @ 2.5%		DATE		
			REV	MFG. LOG.	DWG. NO. 3PTN735-1000K-E2
			DATE:	DWG. FILE	